


Northrop Grumman

Pathway to enhanced risk reduction

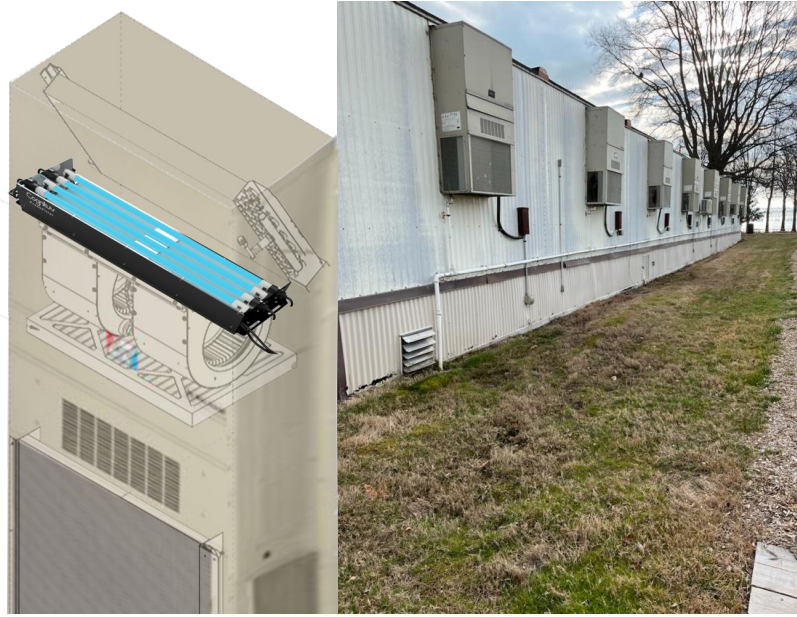

Identify

Personnel complaints regarding air quality and a musty Mold smell. Coastal regions notoriously have mold and mildew problems. HVAC manufacturer warns against using product in such areas.

Apply


A Cognituv Fresh Filter system was engineered to be seamlessly integrated in the Mobile Exterior Bard HVAC Units for continuous coil and purifying air treatment.

Verify

No complaints regarding poor air quality have been reported since the system went in 18 months later. Facilities Engineer states confidence in keeping important DOD operations facilities open longer than planned.

Successful Outcomes

- Automated Maintenance: to reduce the need for manual cleaning.
- Energy Savings: Improved HVAC efficiency led to lower energy consumption.
- Improved Indoor Air Quality (IAQ)
- Reduced Filter Changes
- Enhanced life-span of HVAC & modular facilities.

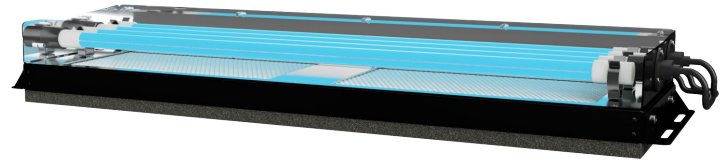

AT A GLANCE

Aerospace/ Defense Sector

Modular Facilities

Annapolis, Maryland



Cognituv.com
Spicewood, Texas
Team@Cognituv.com
1-888-580-8738